

088W-3053 (Ve)
X: 149527
Y: 172003




SGS Geologica
A Division of SGS Belgium NV

Zetel Bertem
Tervuursesteenweg 200
B-3060 Bertem
Tel : +32 (0)16 49 00 39
Fax : +32 (0)16 48 14 19

D45333 - PS8
29/04/2011
hoek Brabant- / Weidestraat, Sint-Joost-ten-Node
Voorboring tot 1,20 m
Met vaste punt op geleidingsbuis geduwd tot 2,00 m

CPT - SE (15 cm²)
200 kN Ontklever
GRW : D 1,20 m

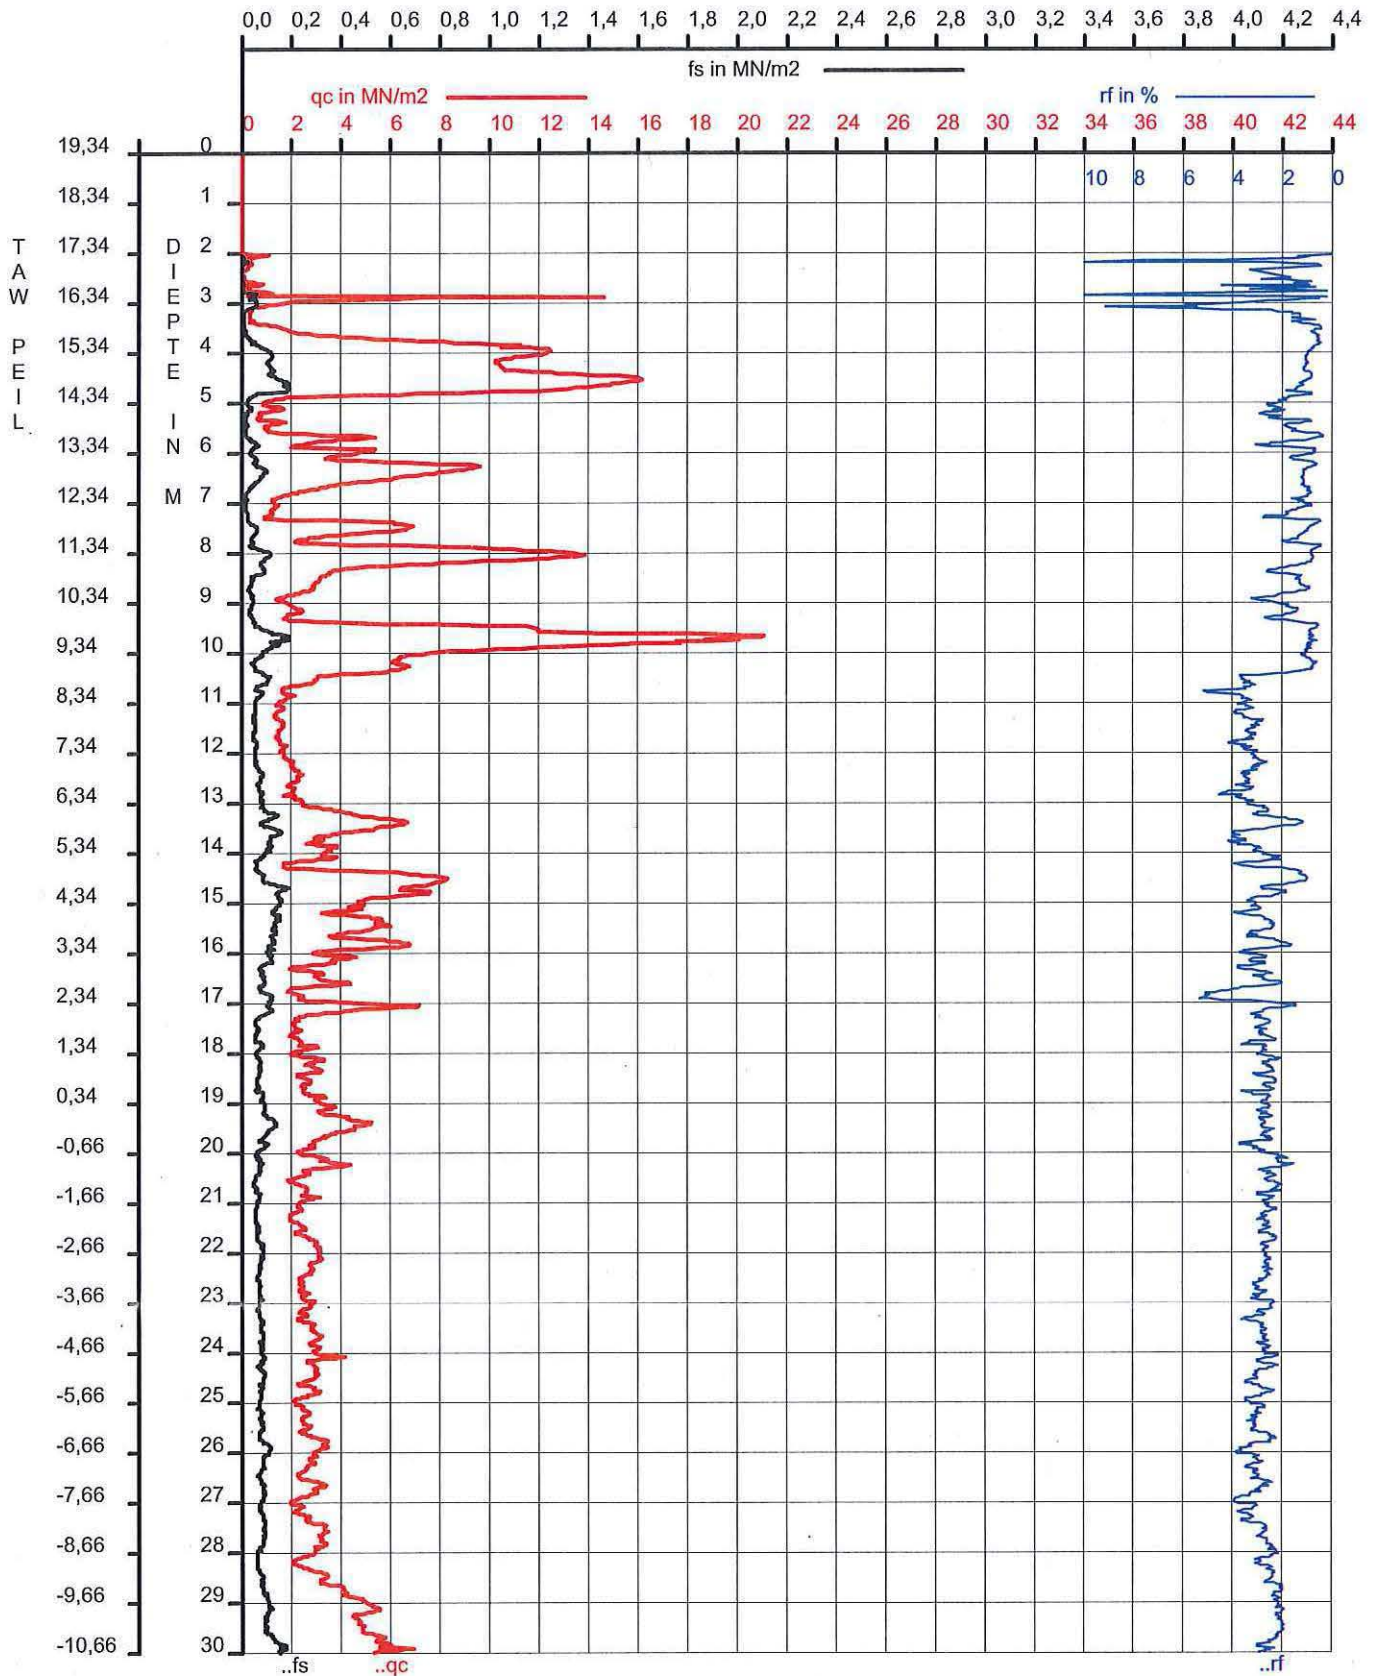

088W-3053 (Ve)



SGS Geologica
A Division of SGS Belgium NV

Zetel Bertem

D45333 - PS8

CPT - SE (15 cm²)

Tervuursesteenweg 200

29/04/2011

200 kN Ontklever

B-3060 Bertem

hoek Brabant- / Weidestraat, Sint-Joost-ten-NodeL

GRW : D 1,20 m

Tel : +32 (0)16 49 00 39

Voorboring tot 1,20 m

Fax : +32 (0)16 48 14 19

Met vaste punt op geleidingsbuis geduwd tot 2,00 m

